

## FEATURES:

- Meet most of safety standards for lighting
- Standard CSA C22.2 NO.141、UL924
- External lithium battery
- Battery protections : over charge protection、over discharge protection、short circuit protection
- Indicator shows a variety working modes
- The batteries Meet 500 cycles of standard CH and standard DCH
- RoHS compliant
- Emergency 1.5H



## CERTIFICATES:



## APPLICATIONS:



TSS / TSC



VTC / VT / VLB




TR



TDS / TL

## DIMENSIONS:


Driver: L\*W\*H=7.4"x1.5"x1.14"(mounting center:7.0")  
Battery Pack: L\*W\*H=4.07"x1.6"x1.17"(mounting center-3.78")

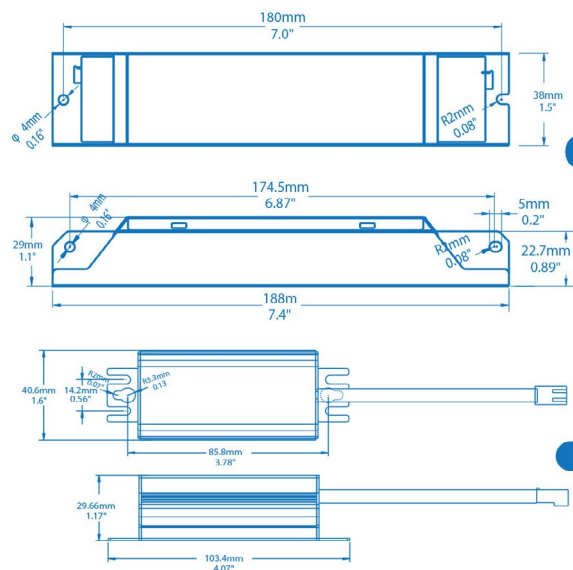

## SPECIFICATIONS:

Universal Input Voltage	100-347-Vac, 50~60Hz	Test Switch Indicator Light	Illuminated Test Switch, indicator light
AC Input Current	100mA max	Battery	Li-ion battery 7.4V/2500mAH
AC Input Power Rating	7 W max	Battery Charging Current	250mA
Output Current and Voltage	140-220mA 36-56V dc	Charging Time	≥24 Hours
Output Power	8 W	Temperature Rating (Ambient)	5°C to +50°C (41°F to 122°F)
Emergency Time	≥1.5H	Dimenions	7.4"x1.5"x1.14"(188x38x29mm)
Full Warranty	5 Years	Weight	0.63lbs (0.29kg)

## WIRING DIAGRAM:

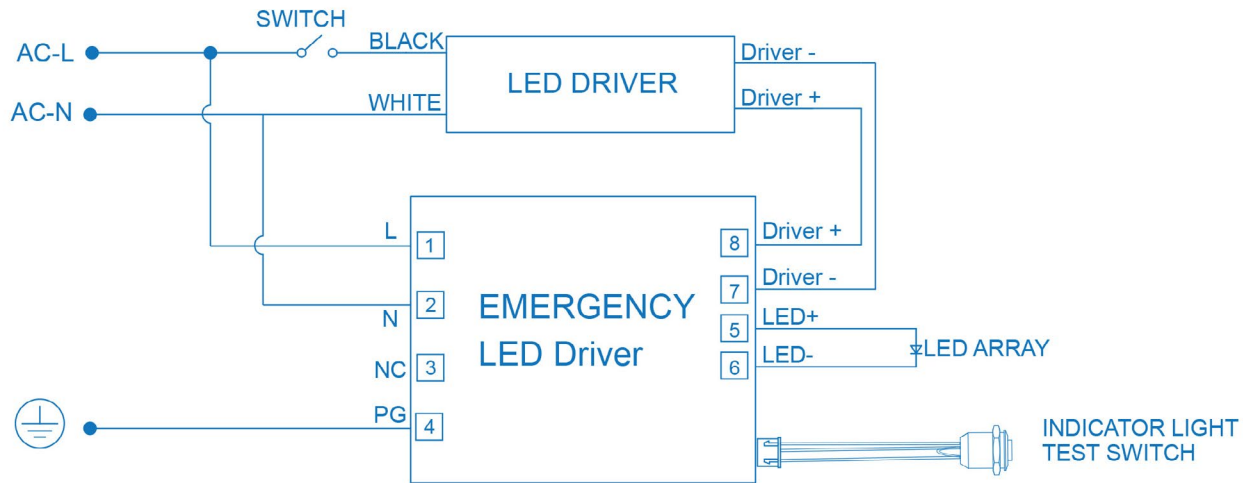

- 1.DO NOT MATE CONNECTOR UNTIL INSTALLATION IS COMPLETE AND AC POWER IS SUPPLIED.
- 2.TEST ACCESSORY LEADS-OBSERVE PROPER POLARITY WIRING.

## OPERATION:

### AC Operation:

AC power is present, the LED load from the LED driver is normal power supply, the emergency driver is charging in a standby mode, the RED indicator light on to indicate that it is charging.

### Emergency operation:

When AC power goes out, the emergency driver detects the AC power outage and automatically switch to emergency mode, the indicator light off. When the AC power is restored,the emergency driver back to AC mode and starts re-charging, the RED indicator light

## IMPORTANT SAFEGUARDS

When using electrical equipment, basic safety precautions should always be followed including the following:

### **READ AND FOLLOW ALL SAFETY INSTRUCTIONS.**

- Risk of fire or electric shock. Luminaire wiring and electrical parts may be damaged when drilling for installation of LED Emergency Backup. Check for enclosed wiring and components.
- Risk of fire or electric shock. This LED Emergency Backup installation requires knowledge of luminaire electrical systems. If not qualified, do not attempt installation. Contact a qualified electrician.
- Before installing, make certain the AC power to the fixture is off.
- The electrical rating of this product is 100-347Vac. Installer must confirm that there is 100-347Vac to the fixture before installation.
- To prevent electrical shock only mate unit connector after installation is complete and before the AC power to the fixture is back on.
- Do not use in outdoor.
- This LED Emergency Backup unit requires an un-switched AC power source of 100-347Vac, 50/60Hz. The AC driver must be on the same branch circuit as the LED Emergency Backup unit.
- Do not let power supply cords touch hot surfaces.
- Do not mount near gas or electric heaters.
- Do not connect battery pack connector until all other wiring is complete and AC power is on.
- The emergency LED driver is for use with grounded, UL listed LED luminaires, shall be enclosed by the LED luminaire and bonded to the grounding of LED luminaire.
- Verify that all replacement lamp types marked on the installed luminaire are also identified as suitable for use with this emergency battery pack.
- The battery pack is fixed by screws and the indicator light is installed on the surface of luminaires.
- Equipment should be mounted in locations and at heights where it is not be subjected to tampering by unauthorized personnel.
- The use of accessory equipment is not recommended by the manufacturer and may cause an unsafe condition.
- Do not use this equipment for other than its intended use.
- Use with grounded, UL Listed, dry or damp location rated fixtures.